



Access Compliance Report Public Rights-of-Way (Curb Ramps)




Main Street: NEWPORT_AVE Cross Street: DODGE_AVE Location: SE

ADA ID: RPRK220126111951 Ramp Type: Type 4 - Parallel Initial Pass/Fail: Fail Overall Compliance: No Severity Score: 2

Codes/Mitigation Info/Possible Solution

Field Measurements/Component Compliance

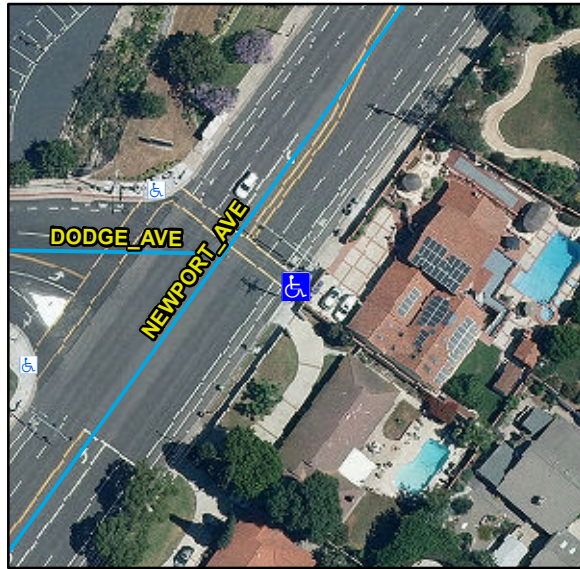

Possible Solutions:

Remove & Replace Entire Ramp. Restripe Crosswalk.

Surveyor Notes:

N/A

OC Std/PROW:

R304.5.3, R302.3, R402.2, STD 1115

Total Cost: \$ 6000

Parcel ID Number 502-221-16
Ramp Island Or Median None
Ramp Orientation NonDiag
Google Street View Link:

Street 1 Name NEWPORT_AVE
Stop Condition-Street 1 Signal
Street 2 Name DODGE_AVE
Stop Condition-Street 2 N/A

http://www.google.com/maps/@?api=1&map_action=pano&viewpoint=33.76588568,-117.79579317

Obstruction and Utility Measurement/Component Compliance

Compliance	Description	Data	Compliance	Description	Data
No	Obstructions Present?	Yes	N/A	Utilities Present?	Yes
	Obstruction Types	Traffic Signal Pole		Utility Types	
	Obstruction Dimensions	N/A		Pull Box; Power Pole	

Compliance	Description	Data	Compliance	Description	Data
N/A	Ramp Length LT (in)	121	N/A	Ramp Length RT (in)	70
Yes	Ramp Width LT (in)	84	Yes	Ramp Width RT (in)	84
Yes	Ramp Run Slope LT (%)	5.2	Yes	Ramp Run Slope RT (%)	6.1
Yes	Ramp Cross Slope LT (%)	1.1	No	Ramp Cross Slope RT (%)	3.1
N/A	Landing Present	N/A	N/A	DWS Provided	N/A
N/A	Landing Length (in)	N/A	N/A	DWS Contrast	N/A
N/A	Landing Width (in)	N/A	N/A	DWS Length (in)	N/A
N/A	Landing Run Slope (%)	N/A	N/A	DWS Full Width	N/A
N/A	Landing Cross Slope (%)	N/A		DWS Offset Type	N/A
N/A	Landing Movement Obstructed?	N/A	N/A	DWS Offset Left (in)	N/A
	Landing Movement Type	N/A	N/A	DWS Offset Right (in)	N/A
N/A	Landing Shared	N/A			
N/A	Clear Space	N/A			
N/A	Clear Space To Crosswalk (in)	N/A			
N/A	Marked Crosswalk 1	Yes	N/A	Marked Crosswalk 2	N/A
	Crossing 1 Direction	NW		Crossing 2 Direction	N/A
	Marked Crosswalk 1 Width (in)	144		Marked Crosswalk 2 Width (in)	N/A
N/A	Ramp Inside Crosswalk 1	No	N/A	Ramp Inside Crosswalk 2	N/A
	Crossing 1 Slope (%)	7.8		Crossing 2 Slope (%)	N/A
	Crossing 1 Cross Slope (%)	3		Crossing 2 Cross Slope (%)	N/A
N/A	Gutter Ponding	N/A	N/A	Curb Slope	3.1
Yes	Gutter Lip Height (in)	0		Road Run Slope (%)	N/A
N/A	Gutter Run Slope (%)	N/A		Road Cross Slope (%)	N/A
N/A	Gutter Cross Slope (%)	N/A	Yes	Perpendicular Joint Present	Yes
Yes	Overall Surface Condition	Acceptable			
	Cross Gutter Present?	No		Spandrel Present?	No
	Replace Cross Gutter?	N/A		Replace Spandrel?	N/A

